

EVANGELINE AQUIFER SUMMARY  
BASELINE MONITORING PROJECT, FY 2001

APPENDIX 4  
OF THE  
TRIENNIAL SUMMARY REPORT, 2003  
FOR THE  
ENVIRONMENTAL EVALUATION DIVISION  
OF  
LOUISIANA DEPARTMENT OF ENVIRONMENTAL QUALITY

PARTIAL FUNDING PROVIDED THROUGH 106 CWA

## EVANGELINE AQUIFER SUMMARY

### TABLE OF CONTENTS

BACKGROUND .....	3
GEOLOGY .....	3
HYDROGEOLOGY .....	3
INTERPRETATION OF DATA .....	4
FIELD, WATER QUALITY, AND NUTRIENTS PARAMETERS .....	4
INORGANIC PARAMETERS.....	5
VOLATILE ORGANIC COMPOUNDS .....	5
SEMIVOLATILE ORGANIC COMPOUNDS .....	6
PESTICIDES AND PCBs.....	6
COMMON WATER CHARACTERISTICS .....	7
Table 4-1 Common Water Characteristics .....	7
SUMMARY AND RECOMMENDATIONS.....	8
Table 4-2 List of Project Wells Sampled .....	9
Table 4-3 Summary of Field, Water Quality, and Nutrients Data .....	10
Table 4-4 Summary of Inorganic Data.....	11
Table 4-5 Field, Water Quality, and Nutrients Statistics .....	12
Table 4-6 Inorganic Statistics.....	12
Table 4-7 Three-year Field, Water Quality, and Nutrients Statistics.....	13
Table 4-8 Three-year Inorganic Statistics .....	13
Table 4-9 List of VOC Analytical Parameters .....	14
Table 4-10 List of Semi-volatile Analytical Parameters .....	15
Table 4-11 List of Pesticide and PCB Analytical Parameters.....	17
Figure 4-1 Location Plat, Evangeline Aquifer.....	18
Figure 4-2 Map of pH Data .....	19
Figure 4-3 Map of TDS Data.....	20
Figure 4-4 Map of Chloride Data .....	21
Figure 4-5 Map of Iron Data.....	22

## **BACKGROUND**

In order to better assess the water quality of a particular aquifer at a given point in time, an attempt was made during the project year to sample all Baseline Monitoring Project (Project or BMP) wells producing from a common aquifer in a narrow time frame. Also, to more conveniently and economically promulgate those data collected from a particular aquifer, a summary report on each aquifer sampled was prepared separately. Collectively, these aquifer summaries will make up part of the Project Triennial Summary Report.

Figure 4-1 shows the geographic locations of the Evangeline aquifer and the associated Project wells, whereas Table 4-2 lists the wells in the aquifer along with their total depths and the use made of produced waters and date sampled.

In January of 2001, eleven wells were sampled which produce from the Evangeline aquifer. Seven of the wells are classified as public supply wells, one well is classified as domestic, one as industrial, and one as an irrigation well. The remaining well is classified as “other” by the Louisiana Department of Transportation and Development (LDOTD), however it is used as a public supply well. The wells are located in seven parishes from the central to the southwest part of the state.

Well data for registered water wells were obtained from the Louisiana Department of Transportation and Development’s Water Well Registration Data file.

## **GEOLOGY**

The Evangeline aquifer is comprised of unnamed Pliocene sands and the Pliocene-Miocene Blounts Creek member of the Fleming formation. The Blounts Creek consists of sands, silts, and silty clays, with some gravel and lignite. The sands of the aquifer are moderately well to well sorted and fine to medium grained with interbedded coarse sand, silt, and clay. The mapped outcrop corresponds to the outcrop of the Blounts Creek member, but down dip, the aquifer thickens and includes Pliocene sand beds that do not outcrop. The confining clays of the Castor Creek member (Burkeville aquiclude) retard the movement of water between the Evangeline and the underlying Miocene aquifer systems. The Evangeline is separated in most areas from the overlying Chicot aquifer by clay beds; in some areas the clays are missing and the upper sands of the Evangeline are in direct contact with the lower sands and gravels of the Chicot.

## **HYDROGEOLOGY**

Recharge to the Evangeline aquifer occurs by the direct infiltration of rainfall in interstream, upland outcrop areas and the movement of water through overlying terrace deposits, as well as leakage from other aquifers. Fresh water in the Evangeline is separated from water in stratigraphically equivalent deposits in southeast Louisiana by a saltwater ridge in the Mississippi River valley. The hydraulic conductivity of the Evangeline varies between 20-100 feet/day.

The maximum depths of occurrence of freshwater in the Evangeline range from 150 feet above sea level, to 2,250 feet below sea level. The range of thickness of the fresh water interval in the Evangeline is 50 to 1,900 feet. The depths of the Evangeline wells that were monitored in conjunction with the BMP range from 170 to 1,715 feet.

## INTERPRETATION OF DATA

### FIELD, WATER QUALITY, AND NUTRIENTS PARAMETERS

Table 4-3 lists the field parameters that are checked and the water quality and nutrients parameters that are sampled for at each well. It also shows the field results and the water quality and nutrients analytical results for each well. Table 4-5 provides an overview of field data, water quality data, and nutrients data for the Evangeline aquifer, listing the minimum, maximum, and average results for these parameters.

#### Federal Primary Drinking Water Standards

Under the Federal Safe Drinking Water Act, EPA has established maximum contaminant levels (MCLs) for pollutants that may pose a health risk in public drinking water. An MCL is the highest level of a contaminant that EPA allows in public drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. While not all wells sampled were public supply wells, this Office does use the MCLs as a benchmark for further evaluation.

A review of the analyses listed on Table 4-3 shows that no primary MCL was exceeded for field, water quality, or nutrients parameters.

#### Federal Secondary Drinking Water Standards

EPA has set secondary standards that are defined as non-enforceable taste, odor, or appearance guidelines.

Field and laboratory data contained in Table 4-3 show that the following secondary MCLs (SMCLs) were exceeded.

#### Color – SMCL = 15 PCU

EV-858 – 20 PCU, duplicate – 25 PCU

#### Total Dissolved Solids (TDS) – SMCL = 500 ppm

AV-441 – 602 ppm

EV-858 – 538 ppm, duplicate – 556 ppm

#### Comparison To Historical Data

Table 4-7 lists the current field, water quality, and nutrients data averages alongside those parameters' data averages for the two previous sampling rotations (three and six years prior). A comparison of these averages show that the water quality characteristics of ground water produced from the Evangeline aquifer has not changed significantly since the 1995 fiscal year (FY) sampling.

## INORGANIC PARAMETERS

Table 4-4 shows the inorganic (total metals) parameters that are sampled for and the analytical results for those parameters for each well. Table 4-6 provides an overview of inorganic data for the Evangeline aquifer, listing the minimum, maximum, and average results for these parameters.

### Federal Primary Drinking Water Standards

A review of the analyses listed on Table 4-4 shows that no primary MCL was exceeded for total metals.

### Federal Secondary Drinking Water Standards

Laboratory data contained in Table 4-4 show that the following secondary MCL (SMCL) was exceeded.

Iron – SMCL = 300 ppb

CA-1362 – 440 ppb

### Comparison To Historical Data

Table 4-8 lists the current inorganic data averages alongside the inorganic data averages for the two previous sampling rotations (three and six years prior). A comparison of these averages show that while there are some general fluctuations over the six-year period, for the most part, the inorganic characteristics of ground water produced from the Evangeline aquifer has not changed significantly since the FY 1995 sampling.

## VOLATILE ORGANIC COMPOUNDS

Table 4-9 shows the volatile organic compound (VOC) parameters that are sampled for. Due to the large number of analytes in this category, a total list of the analytical results for each analyte is not provided, however any detection of a VOC would be discussed in this section.

No VOC was detected during the 2001 sampling of the Evangeline aquifer.

## SEMIVOLATILE ORGANIC COMPOUNDS

Table 4-10 shows the semivolatile organic compound parameters that are sampled for. Due to the large number of analytes in this category, a total list of the analytical results for each analyte is not provided, however any detection of a semivolatile would be discussed in this section.

### Federal Primary Drinking Water Standards

Laboratory data show that ten wells exceeded the MCL of 6 parts per billion (ppb) for bis(2-ethylhexyl)phthalate (BEHP). However, every well that was sampled in the Evangeline, as well as both field blanks and one of the laboratory blanks, exhibited values for BEHP. Therefore, it is this Office's opinion that the values exhibited for BEHP are due to laboratory or field contamination and are considered invalid.

Taking into consideration the invalid BEHP concentrations, no primary MCL was exceeded for the semivolatile parameters.

### Federal Secondary Drinking Water Standards

None of the semivolatiles sampled have current SMCLs.

### Detection of Semivolatiles With No Standards

There were no detections of semivolatiles that fit under this category.

## PESTICIDES AND PCBS

Table 4-11 shows the pesticide and PCB parameters that are sampled for. Due to the large number of analytes in this category, a total list of the analytical results for each analyte is not provided, however any detection of a pesticide or PCB would be discussed in this section.

No pesticide or PCB was detected during the 2001 sampling of the Evangeline aquifer.

COMMON WATER CHARACTERISTICS

Table 4-1 below highlights some of the more common water characteristics that are considered when studying ground water quality. The minimum, maximum, and average values that were found during the current sampling of the Evangeline aquifer for pH, TDS, hardness, chloride, iron, and nitrite-nitrate are listed in the table. Figures 4-2, 4-3, 4-4, and 4-5 respectively, represent the contoured data for pH, TDS, chloride, and iron. The data average for hardness shows that the ground water produced from this aquifer is generally soft<sup>1</sup>.

**Table 4-1 Common Water Characteristics**  
Fiscal Year 2001

PARAMETER	MINIMUM	MAXIMUM	AVERAGE
pH (SU)	5.49	8.73	7.05
TDS (ppm)	35.7	602.0	220.1
Hardness (ppm)	<5	50.9	19.7
Chloride (ppm)	3.3	97.5	22.4
Iron (ppb)	10.00	440.0	93.58
Nitrite-Nitrate, as N (ppm)	0.03	0.06	0.03

<sup>1</sup> Classification based on hardness scale from: Peavy, H.S. et al. *Environmental Engineering*, 1985.

## **SUMMARY AND RECOMMENDATIONS**

In summary, the data show that the ground water produced from this aquifer is generally soft, and is of good quality when considering short-term or long-term health risk guidelines. Laboratory data show that no project well that was sampled during the Fiscal Year 2001 monitoring of the Evangeline aquifer exceeded a primary MCL. The data also show that this aquifer is of good quality when considering taste, odor, or appearance guidelines. A comparison to historical BMP data show that while there are some general fluctuations, for the most part, the characteristics of the ground water produced from the Evangeline aquifer has not changed significantly since the FY 1995 sampling.

It is recommended that the Project wells assigned to the Evangeline aquifer be re-sampled as planned in approximately three years. In addition, several wells should be added to the eleven currently in place to increase the well density for this aquifer.

**Table 4-2 List of Project Wells Sampled**

<b>PROJECT NUMBER</b>	<b>PARISH</b>	<b>WELL NUMBER</b>	<b>DATE SAMPLED</b>	<b>OWNER</b>	<b>DEPTH (FEET)</b>	<b>WELL USE</b>
198601	ALLEN	AL-120	01/09/2001 01/22/2001	CITY OF OAKDALE	910	PUBLIC SUPPLY
199504	ALLEN	AL-363	01/09/2001 01/22/2001	WEST ALLEN PARISH WATER DIST.	1715	PUBLIC SUPPLY
200102	ALLEN	AL-391	01/09/2001	FAIRVIEW WATER SYSTEM	800	PUBLIC SUPPLY
199327	AVOYELLES	AV-441	01/23/2001	TOWN OF EVERGREEN	319	PUBLIC SUPPLY
199119	BEAUREGARD	BE-410	01/09/2001 01/22/2001	BOISE CASCADE	474	INDUSTRIAL
199505	BEAUREGARD	BE-512	01/08/2001 01/22/2001	SINGER WATER DISTRICT	918	PUBLIC SUPPLY
200103	CALCASIEU	CU-1362	01/08/2001 01/22/2001	LA WATER CO	635	PUBLIC SUPPLY
199503	EVANGELINE	EV-858	01/23/2001	SAVOY SWORDS WATER SYSTEM	472	PUBLIC SUPPLY
199313	RAPIDES	R-1350	01/23/2001	PRIVATE OWNER	180	IRRIGATION
199506	VERNON	V-5065Z	01/22/2001	PRIVATE OWNER	170	DOMESTIC
200101	VERNON	V-668	01/09/2001 01/22/2001	LDWF/FORT POLK WMA HQ	280	OTHER

**Table 4-3 Summary of Field, Water Quality, and Nutrients Data**

WELL NUMBER	COND. MMHOS/CM	PH SU	SAL. PPT	TEMP. OC	ALK. PPM	CL PPM	COLOR PCU	COND. UMHOS/CM	SO4 PPM	TDS PPM	TSS PPM	TURB. NTU	NH3 (AS N) PPM	HARD. PPM	NITRITE-NITRATE (AS N) PPM	TKN PPM	TOT. P PPM
AL-120	0.3	8.3	0.14	23.18	154.0	4.20	2.0	312.0	7.10	184.0	<4.0	<1.0	<0.10	<5.0	<0.05	0.18	0.11
AL-363	0.486	8.73	0.23	23.64	256.0	4.20	26.0	500.0	3.10	278.0	<4.0	<1.0	<0.10	<5.0	<0.05	0.24	0.28
AL-391	0.24	7.99	0.11	22.18	120.0	4.90	2.0	246.0	6.20	141.0	<4.0	<1.0	0.12	35.9	<0.05	0.39	0.09
AV-441	1.051	6.51	0.52	20.07	415.0	96.20	14.0	1000.0	9.40	602.0	<4.0	<1.0	0.36	14.2	<0.05	0.60	0.12
BE-410	0.182	7.45	0.09	21.81	86.9	5.70	<5.0	189.0	3.20	119.0	<4.0	<1.0	<0.10	50.9	0.05	<0.10	0.06
BE-512	No Data			24.16	164.0	5.50	2.0	333.0	6.50	182.0	<4.0	<1.0	<0.10	<5.0	<0.05	0.58	0.08
BE-512*	No Data			24.16	164.0	5.40	2.0	322.0	6.60	196.0	<4.0	<1.0	<0.10	<5.0	<0.05	0.15	0.10
CA-1362	0.282	6.48	0.13	23.18	126.0	15.80	3.0	285.0	2.40	183.0	<4.0	<1.0	<0.10	37.8	<0.05	0.13	0.28
EV-858	No Data				358.0	97.50	20.0	930.0	<1.25	538.0	<4.0	<1.0	0.44	39.9	<0.05	0.68	0.27
EV-858*	No Data				357.0	97.40	25.0	934.0	<1.25	556.0	<4.0	<1.0	0.47	40.0	<0.05	0.69	0.34
R-1350	0.072	5.49	0.03	18.86	22.8	4.10	5.0	72.6	6.30	89.3	<4.0	1.0	<0.10	8.4	<0.05	0.32	<0.05
V-5065Z	0.071	5.6	0.03	15.69	26.8	5.00	<5.0	72.0	1.70	69.3	<4.0	<1.0	<0.10	14.8	0.06	0.13	<0.05
V-668	0.035	6.87	0.02	17.68	14.9	3.30	<5.0	35.6	<1.25	35.7	<4.0	<1.0	<0.10	7.5	0.03	<0.10	<0.05

\* Denotes duplicate sample.

**Table 4-4 Summary of Inorganic Data**

WELL NUMBER	ANTIMONY PPB	ARSENIC PPB	BARIUM PPB	BERYLLIUM PPB	CADMIUM PPB	CHROMIUM PPB	COPPER PPB	IRON PPB	LEAD PPB	MERCURY PPB	NICKEL PPB	SELENIUM PPB	SILVER PPB	THALLIUM PPB	ZINC PPB
AL-120	<5.0	<5.0	9.8	<1.0	<1.0	<5.0	<5.0	<20.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	22.8
AL-363	<5.0	<5.0	8.7	<1.0	<1.0	<5.0	<5.0	<20.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	10.0
AL-391	No Data														
AV-441	<5.0	<5.0	57.5	<1.0	<1.0	<5.0	8.1	300.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	15.5
BE-410	<5.0	<5.0	148.0	<1.0	<1.0	<5.0	<5.0	<20.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	<10.0
BE-512	<5.0	<5.0	16.6	<1.0	<1.0	<5.0	<5.0	<20.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	<10.0
CA-1362	<5.0	<5.0	200.0	<1.0	<1.0	<5.0	<5.0	440.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	19.7
EV-858	<5.0	<5.0	230.0	<1.0	<1.0	<5.0	<5.0	93.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	<10.0
EV-858*	<5.0	<5.0	214.0	<1.0	<1.0	<5.0	<5.0	72.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	31.0
R-1350	<5.0	<5.0	73.9	<1.0	1.3	<5.0	32.4	26.4	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	29.2
V-5065Z	<5.0	<5.0	73.9	<1.0	1.3	<5.0	32.4	26.4	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	29.2
V-668	<5.0	<5.0	148.0	<1.0	<1.0	<5.0	<5.0	<20.0	<10.0	<0.05	<5.0	<5.0	<1.0	<5.0	<10.0

\* Denotes duplicate sample.

**Table 4-5 Field, Water Quality, and Nutrients Statistics**  
Fiscal Year 2001

PARAMETER	MINIMUM	MAXIMUM	AVERAGE
pH (SU)	5.49	8.73	7.05
Temperature °C	15.69	24.16	21.05
Sp. Conductivity (mmhos/cm) (Field)	0.035	1.051	0.302
Salinity (ppt)	0.02	0.52	0.14
TSS (ppm)	<4	<4	<4
TDS (ppm)	35.7	602.0	220.1
Alkalinity (ppm)	14.9	415.0	158.6
Hardness (ppm)	<5	50.9	19.7
Turbidity (NTU)	<1	1.00	<1
Sp. Conductivity (umhos/cm) (Lab)	35.6	1000.0	361.4
Color (PCU)	<5	26.0	7.4
Chloride (ppm)	3.3	97.5	22.4
Sulfate (ppm)	<1.25	9.40	4.29
Nitrite-Nitrate, as N (ppm)	0.03	0.06	0.03
Phosphorus (ppm)	<0.05	0.28	0.12
TKN (ppm)	<0.10	0.68	0.30
Ammonia (ppm)	<0.1	0.44	0.12

**Table 4-6 Inorganic Statistics**  
Fiscal Year 2001

PARAMETER	MINIMUM	MAXIMUM	AVERAGE
Antimony (ppb)	<5	<5	<5
Arsenic (ppb)	<5	<5	<5
Barium (ppb)	8.7	230.00	96.64
Beryllium (ppb)	<2	<2	<2
Cadmium (ppb)	<2	<2	<2
Chromium (ppb)	<5	<5	<5
Copper (ppb)	<5	32.40	9.04
Iron (ppb)	<20.00	440.00	93.58
Lead (ppb)	<10	<10	<10
Mercury (ppb)	<0.05	<0.05	<0.05
Nickel (ppb)	<5	<5	<5
Selenium (ppb)	<5	<5	<5
Silver (ppb)	<1	<1	<1
Thallium (ppb)	<5	<5	<5
Zinc (ppb)	<10	29.20	14.64

**Table 4-7 Three-year Field, Water Quality, and Nutrients Statistics**

<b>PARAMETER</b>	<b>FY 1995 AVERAGE</b>	<b>FY 1998 AVERAGE</b>	<b>FY 2001 AVERAGE</b>
pH (SU)	7.19	7.04	7.05
Temperature °C	23.31	22.92	21.05
Sp. Conductivity (mmhos/cm) (Field)	0.568	0.524	0.302
Salinity (ppt)	0.26	0.22	0.14
TSS (ppm)	<4	<4	<4
TDS (ppm)	337.8	338.6	220.1
Alkalinity (ppm)	220.6	197.7	158.6
Hardness (ppm)	14.3	12.2	19.7
Turbidity (NTU)	<1	<1	<1
Sp. Conductivity (umhos/cm) (Lab)	543.4	470.3	361.4
Color (PCU)	30.0	7.5	7.4
Chloride (ppm)	23.8	29.6	22.4
Sulfate (ppm)	5.28	4.27	4.29
Nitrite-Nitrate, as N (ppm)	<0.02	0.03	0.03
Phosphorus (ppm)	0.16	0.15	0.12
TKN (ppm)	0.59	0.18	0.30
Ammonia (ppm)	0.19	0.17	0.12

**Table 4-8 Three-year Inorganic Statistics**

<b>PARAMETER</b>	<b>FY 1995 AVERAGE</b>	<b>FY 1998 AVERAGE</b>	<b>FY 2001 AVERAGE</b>
Antimony (ppb)	<5	No Data	<5
Arsenic (ppb)	<5	<5	<5
Barium (ppb)	63.61	45.95	96.64
Beryllium (ppb)	<2	<2	<2
Cadmium (ppb)	<2	<2	<2
Chromium (ppb)	<5	<5	<5
Copper (ppb)	19.82	50.45	9.04
Iron (ppb)	142.35	116.35	93.58
Lead (ppb)	<10	<10	<10
Mercury (ppb)	<0.05	<0.05	<0.05
Nickel (ppb)	5.56	<5	<5
Selenium (ppb)	<5	<5	<5
Silver (ppb)	<1	1.19	<1
Thallium (ppb)	<5	<5	<5
Zinc (ppb)	150.40	114.58	14.64

**Table 4-9 List of VOC Analytical Parameters**  
BASELINE MONITORING PROJECT

VOLATILE ORGANICS BY EPA METHOD 624

COMPOUND	PQL (ppb)
CHLOROMETHANE	2
VINYL CHLORIDE	2
BROMOMETHANE	2
CHLOROETHANE	2
TRICHLOROFLUOROMETHANE	5
1,1-DICHLOROETHENE	2
METHYLENE CHLORIDE	2
TRANS-1,2-DICHLOROETHENE	2
METHYL-t-BUTYL ETHER	2
1,1-DICHLOROETHANE	2
CHLOROFORM	2
1,1,1-TRICHLOROETHANE	2
CARBON TETRACHLORIDE	2
BENZENE	2
1,2-DICHLOROETHANE	2
TRICHLOROETHENE	2
1,2-DICHLOROPROPANE	2
BROMODICHLOROMETHANE	2
CIS-1,3-DICHLOROPROPENE	2
TOLUENE	2
TRANS-1,3-DICHLOROPROPENE	2
1,1,2-TRICHLOROETHANE	2
TETRACHLOROETHENE	2
DIBROMOCHLOROMETHANE	2
CHLOROBENZENE	2
ETHYLBENZENE	2
P&M XYLENE	4
O-XYLENE	2
STYRENE	2
BROMOFORM	2
1,1,2,2-TETRACHLOROETHANE	2
1,3-DICHLOROBENZENE	2
1,4-DICHLOROBENZENE	2
1,2-DICHLOROBENZENE	2

PQL = Practical Quantitation Limit  
ppb = parts per billion

**Table 4-10 List of Semi-volatile Analytical Parameters  
BASELINE MONITORING PROJECT**

SEMIVOLATILE ORGANICS BY EPA METHOD 625

COMPOUND	PQL (ppb)
N-Nitrosodimethylamine	2
Chlorobenzene	2
Phenol	2
Bis(2-chloroethyl) ether	2
2-Chlorophenol	2
1,3-Dichlorobenzene	2
1,4-Dichlorobenzene	2
1,2-Dichlorobenzene	2
Bis(2-chloroisopropyl) ether	6
N-Nitroso-di-n-propylamine	4
Hexachloroethane	2
Nitrobenzene	2
Isophorone	2
2,4-Dimethylphenol	4
2-Nitrophenol	6
1,3,5-Trichlorobenzene	2
Bis(2-chloroethoxy)methane	2
1,2,4-Trichlorobenzene	2
Naphthalene	2
2,4-Dichlorophenol	4
Hexachlorobutadiene	2
1,2,3-Trichlorobenzene	2
4-Chloro-3-methylphenol	4
Hexachlorocyclopentadiene	6
1,2,4,5-Tetrachlorobenzene	2
2,4,6-Trichlorophenol	6
1,2,3,4-Tetrachlorobenzene	2
2-Chloronaphthalene	2
Dimethylphthalate	2
2,6-Dinitrotoluene	4
Acenaphthylene	2
4-Nitrophenol	6
2,4-Dinitrophenol	12
Acenaphthene	2
Pentachlorobenzene	2
2,4-Dinitrotoluene	6
Diethylphthalate	2
4-Chlorophenyl phenyl ether	2
Fluorene	2

**Table 4-10 (Cont'd)**  
Semivolatile Parameters


COMPOUND	PQL (ppb)
4,6-Dinitro-2-methylphenol	12
N-Nitrosodiphenylamine/Dipheny	2
4-Bromophenyl phenyl ether	2
Hexachlorobenzene	2
Pentachlorophenol	10
Phenathrene	2
Anthracene	2
Di-n-butylphthalate	2
Fluoranthene	2
Benzidine	20
Pyrene	2
Butylbenzylphthalate	2
Bis(2-ethylhexyl)phthalate	2
3,3'-Dichlorobenzidine	10
Benzo(a)anthracene	6
Chrysene	4
Di-n-octylphthalate	2
Benzo(b)fluoranthene	6
Benzo(k)fluoranthene	6
Benzo(a)Pyrene	6
Indeno(1,2,3-cd)pyrene	6
Dibenz(a,h)anthracene	6
Benzo(g,h,i)perylene	6

**Table 4-11 List of Pesticide and PCB Analytical Parameters**  
BASELINE MONITORING PROJECT

SEMIVOLATILE ORGANICS BY EPA METHOD 625

COMPOUND	PQL (ppb)
Alpha BHC	2
Beta BHC	2
Gamma BHC	2
Delta BHC	2
Heptachlor	2
Aldrin	2
Heptachlor epoxide	2
Chlordane	2
Endosulfan I	2
4,4-DDE	2
Dieldrin	2
4,4-DDD	2
Endrin	2
Toxaphene	2
Endosulfan II	2
Endrin Aldehyde	2
4,4-DDT	2
Endosulfan Sulfate	2
Methoxychlor	2
Endrin Ketone	2
PCB 1221/ PCB 1232	10
PCB 1016/ PCB 1242	10
PCB 1254	10
PCB 1248	10
PCB 1260	10

# BASELINE MONITORING PROJECT WELLS OF THE EVANGELINE AQUIFER

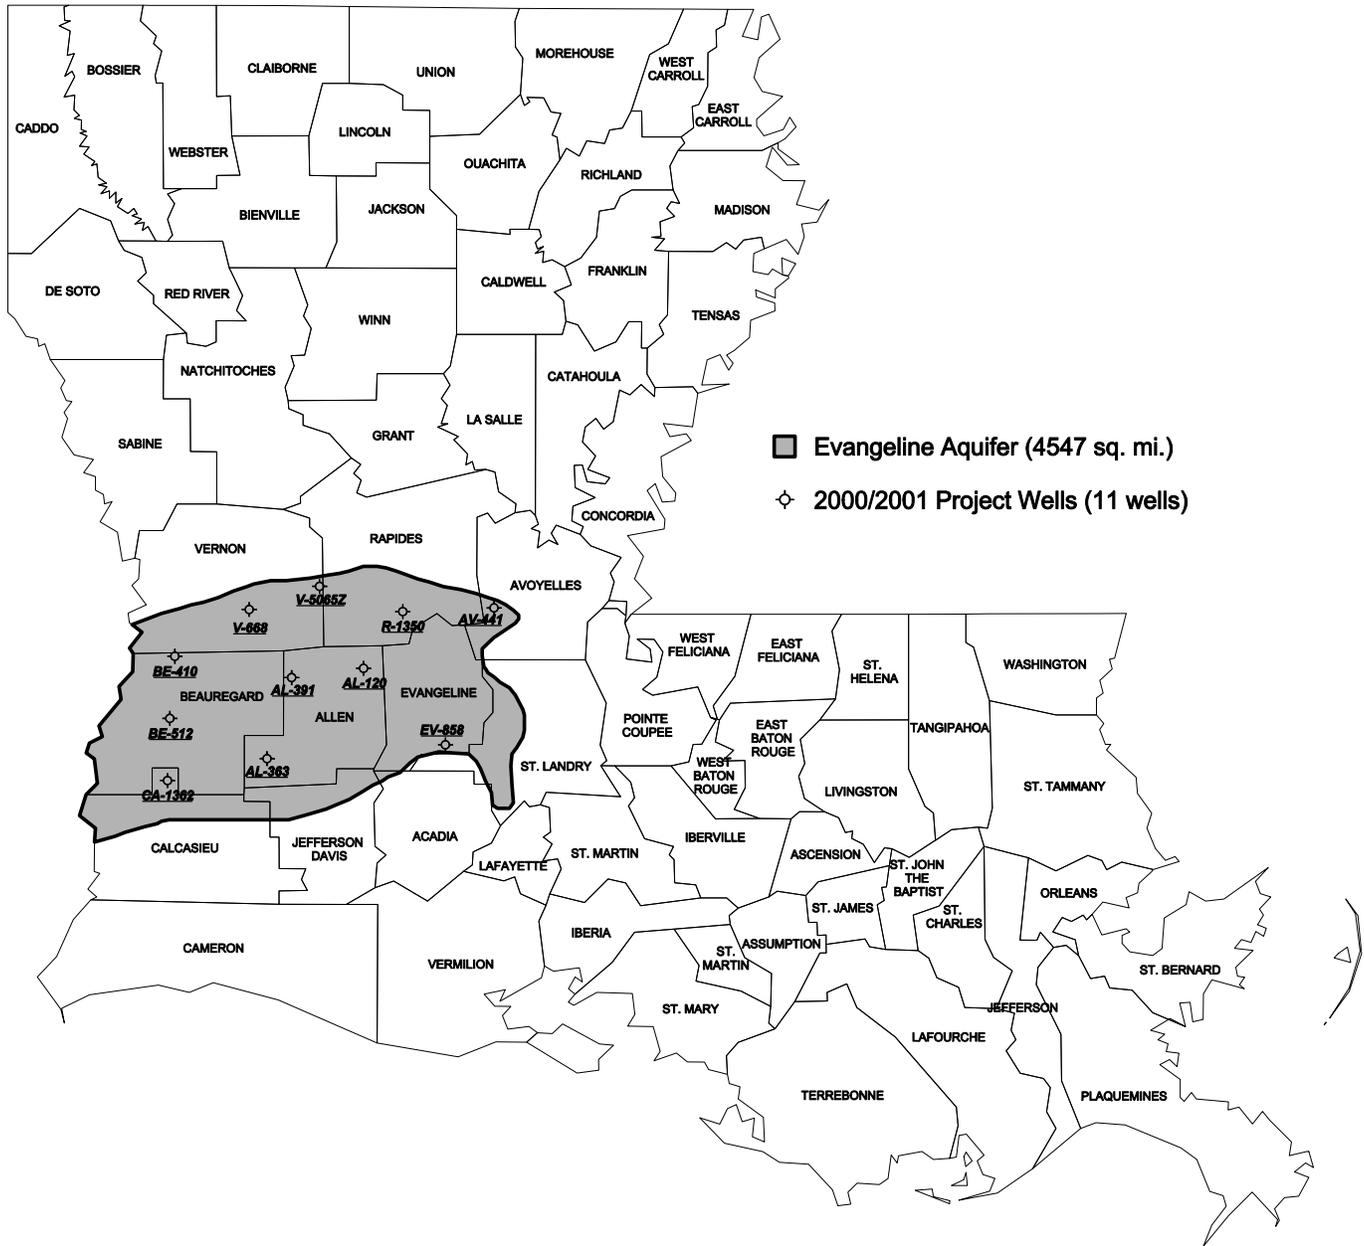

Aquifer boundary digitized from Louisiana Hydrologic Map No. 2: Areal Extent of Freshwater in Major Aquifers of Louisiana, Smoot, 1986; USGS/LDOTD Report 86-4150.

06/31/2001

Figure 4-1 Location Plat, Evangeline Aquifer

# EVANGELINE AQUIFER - pH (SU)

## Baseline Monitoring Project FY00-01

- BE-410 Project Well Location and Designation
- 7.45 pH value (in Standard Units)
- Contour Interval = .5 SU

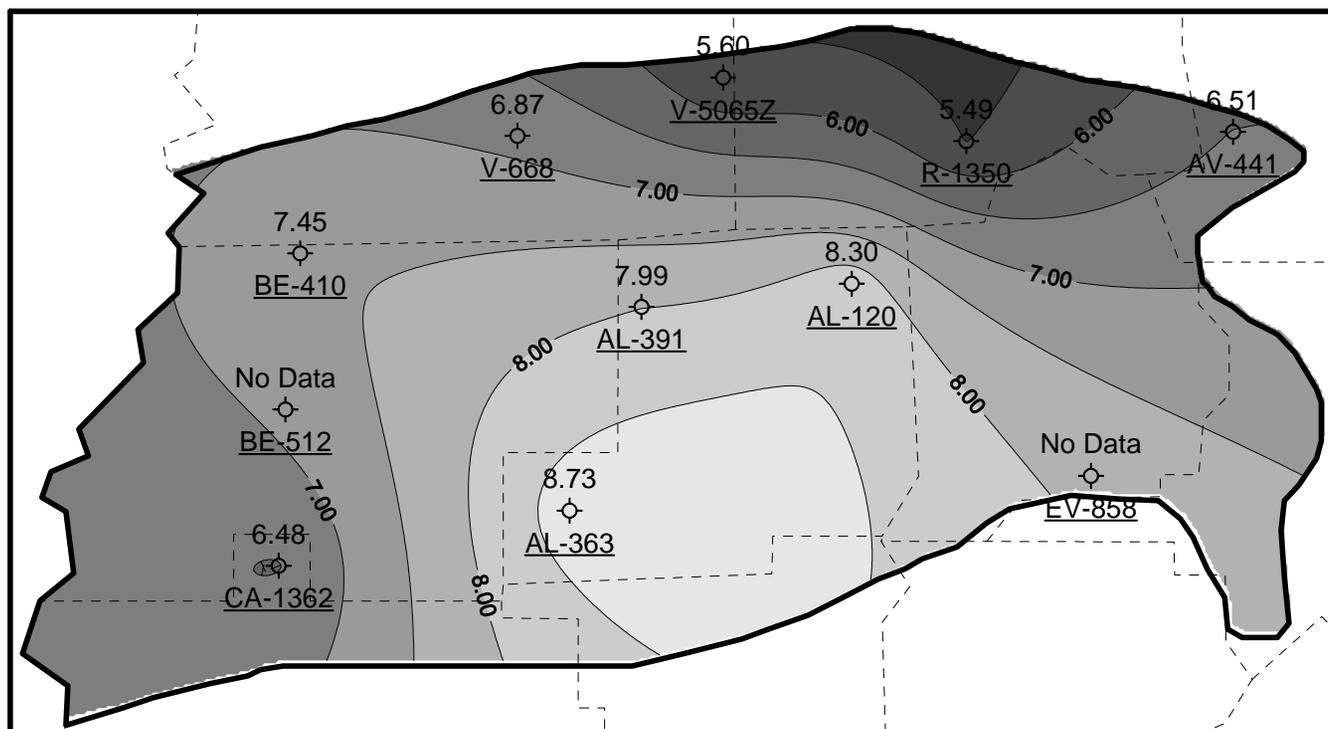
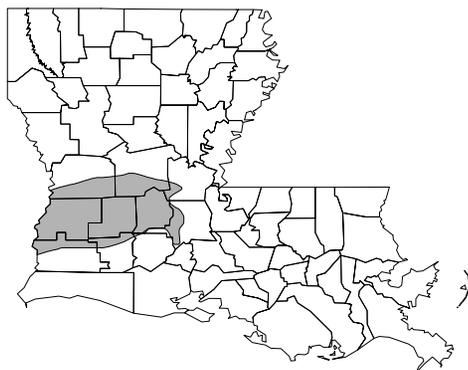


Figure 4-2 Map of pH Data

# EVANGELINE AQUIFER - TDS (PPM)

## Baseline Monitoring Project FY00-01

- BE-410 Project Well Location and Designation
- 119 TDS value (in parts per million)
- Contour Interval = 100 ppm

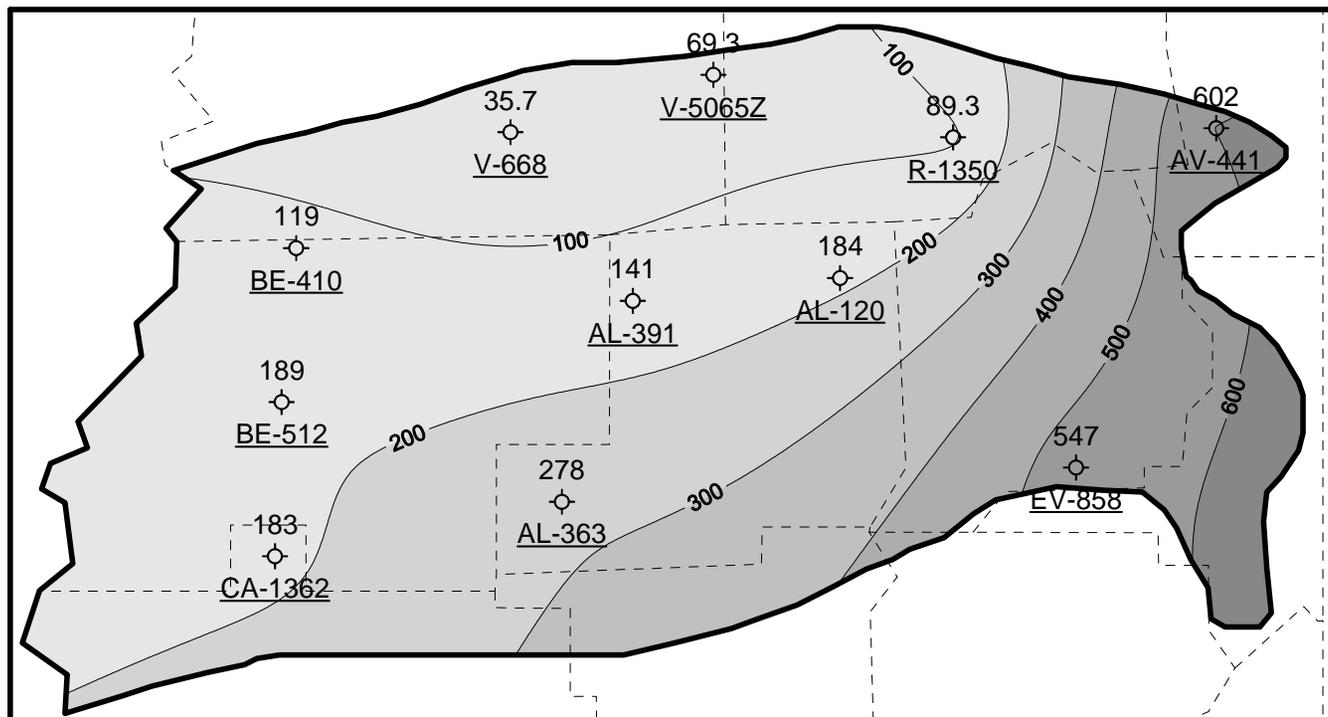
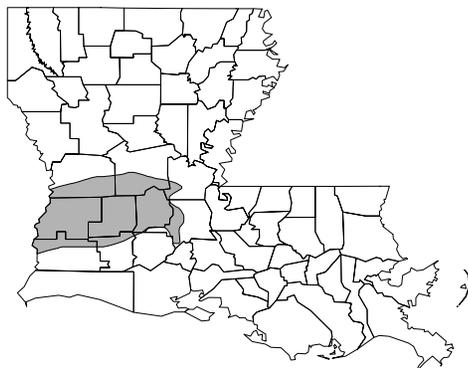


Figure 4-3 Map of TDS Data

# EVANGELINE AQUIFER - CHLORIDE (PPM)

## Baseline Monitoring Project FY00-01

- ⊕ BE-410 Project Well Location and Designation
- 5.7 Chloride value (in parts per million)
- Contour Interval = 20 ppm

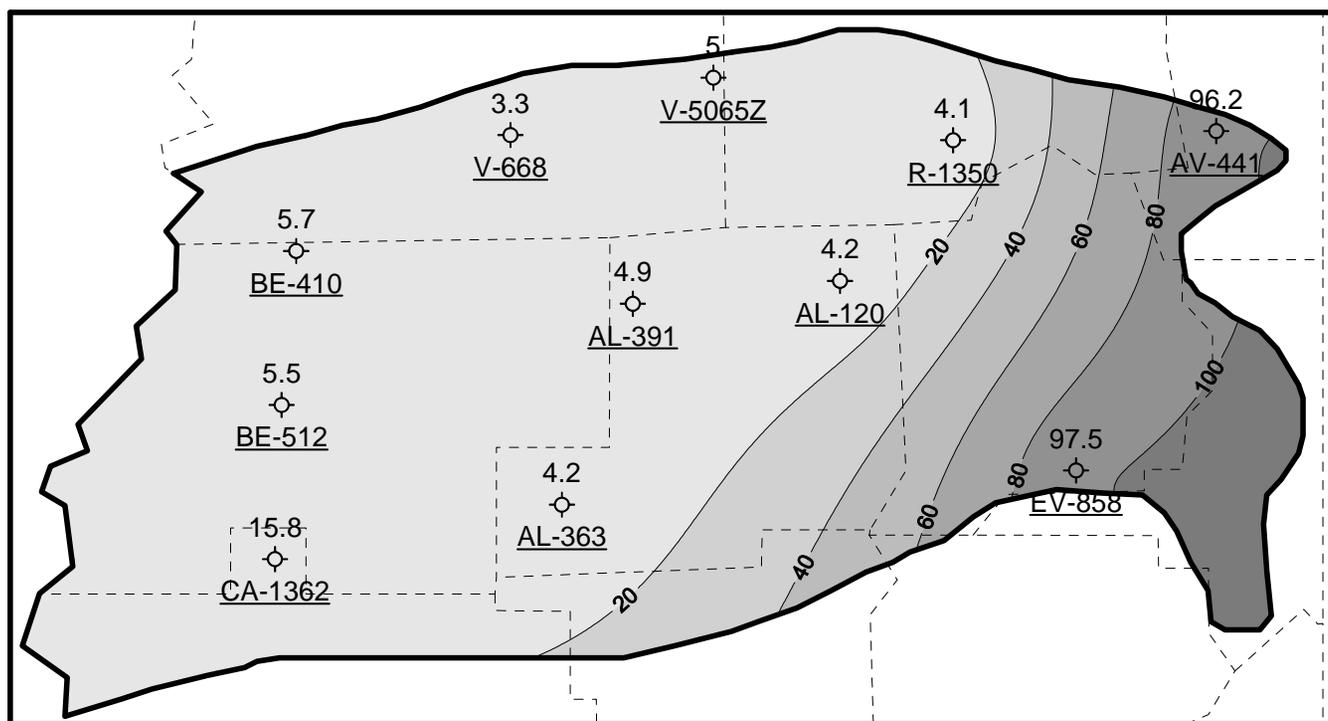
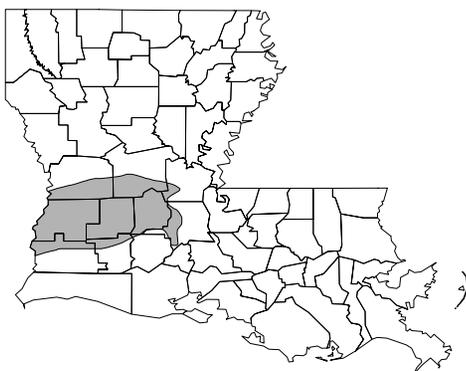


Figure 4-4 Map of Chloride Data

# EVANGELINE AQUIFER - IRON (PPB)

## Baseline Monitoring Project FY00-01

- ⊕ BE-410 Project Well Location and Designation
- <20 Iron value (in parts per billion)
- Contour Interval = 100 ppb

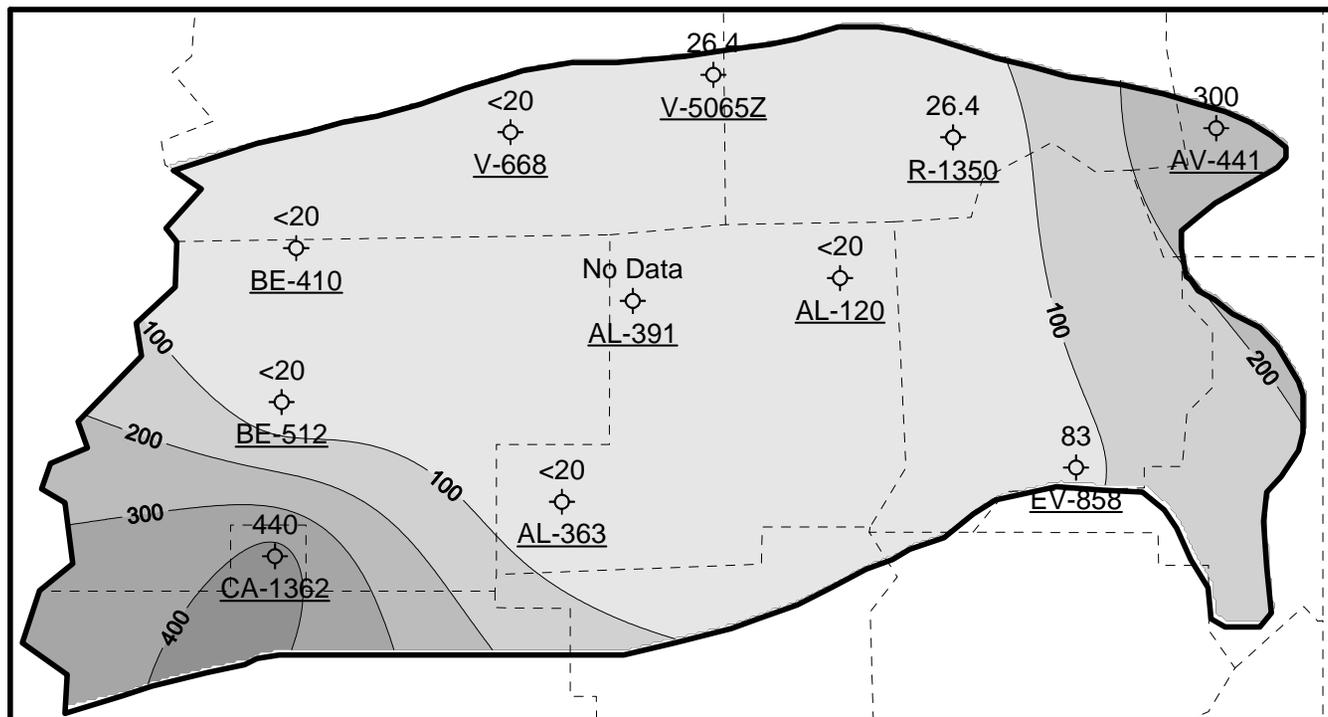
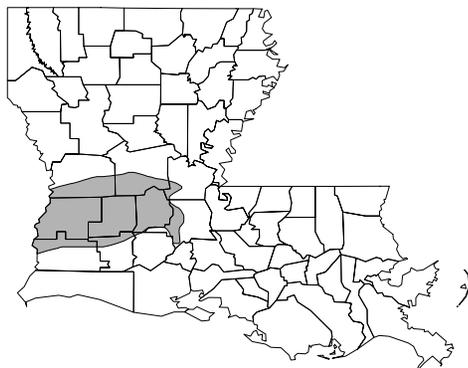


Figure 4-5 Map of Iron Data